

WALL THICKNESS (T)

SMH DIA	T (INCHES)
4'	5"
5'	6"
6'	7"

IN PAVED AREAS SET COLLAR AROUND MH RING 1/8" LOWER THAN FINISH GRADE AT OUTER EDGE AND INNER EDGE.
IN UNPAVED AREAS, SET SMH LID 6" ABOVE EXISTING GROUND OR AS DIRECTED

ADJUST RING TO GRADE AS PER SPECIFICATIONS


STANDARD PRECAST MANHOLE SECTION DEPTH VARIES)

FLEXIBLE BOOT RQD.

TEMPORARY PLUG

LIP OF GROUT CHANNEL

D&L A-1180 30" MANHOLE RING AND COVER TO BE 1/8" BELOW TOP OUTER EDGE OF CONCRETE OR ASPHALT COLLAR

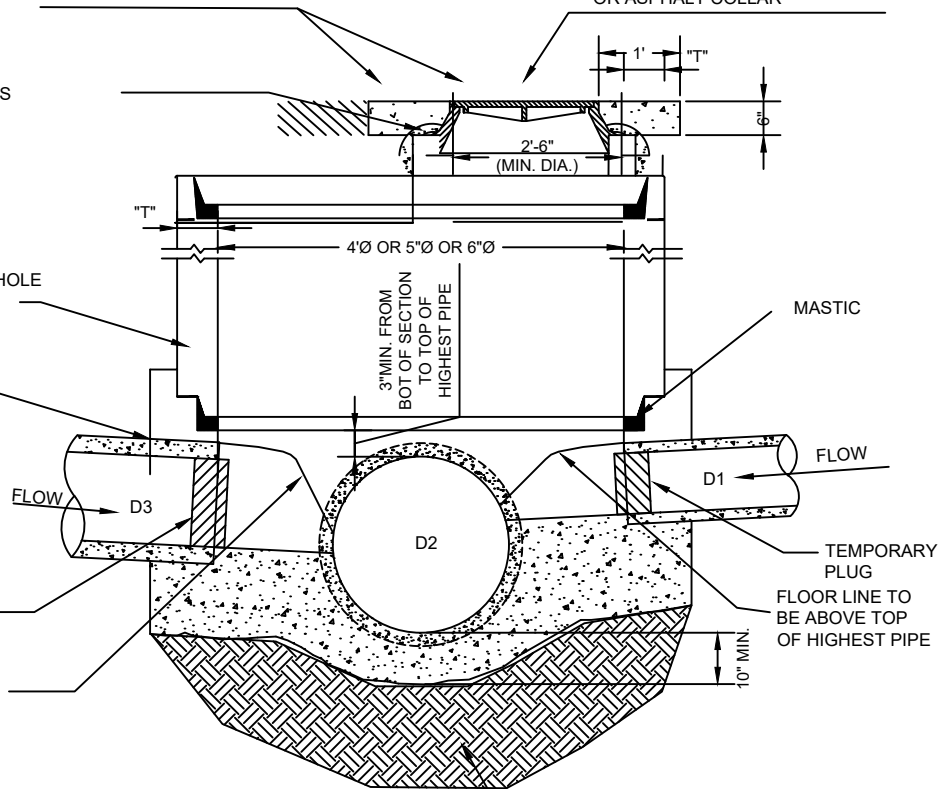

SECTION

PROVIDE 12" THICK MIN. COMPACTED GRAVEL BASE UNDER MH BASE.

NOTES:

- IF GRADE ALLOWS, INVERTS OF D1 & D3 SHALL MATCH THE 0.75 DEPTH POINT OF D2. OTHERWISE AS APPROVED BY DISTRICT.
- AFTER ALL GRADING AROUND MANHOLE HAS BEEN COMPLETED AND FINAL SURFACING IS IN PLACE, REMOVE DEBRIS AND TEMPORARY PLUGS OR PLYWOOD FROM INSIDE OF MANHOLES. SET MANHOLE FRAME AND COVER TO 1/8" BELOW FINISH GRADE AFTER FINAL STREET GRADING
- IS COMPLETE.
CONE AND WALL SECTIONS TO CONFORM TO ASTM C-478
- PLUG OUTLET OF DOWNSTREAM MANHOLE UNTIL CONSTRUCTION IS COMPLETE.

NO SCALE



JORDAN BASIN
IMPROVEMENT DISTRICT

SHALLOW MANHOLE DETAIL

DRAWN:	DESIGNED:	CHECKED:	APPROVED:
DATE	FILE NAME	DRAWING NAME	
AUG 2024		SS-2D	