


PLAN VIEW

NOTES:

1. DROP MANHOLES REQUIRED FOR ANY LINE ENTERING MANHOLE TWO FEET OR MORE ABOVE FLOWLINE OF MAIN LINE.
2. MANHOLES TO CONFORM WITH STANDARD MANHOLE DETAILS (STANDARD No. SS-2A).
3. ALL PIPE AND FITTINGS SHALL CONFORM TO ASTM PE3408 SDR 17 HDPE SEWER PIPE.
4. CONE SHALL BE ROTATED PER INSPECTOR'S RECOMMENDATIONS.
5. DROP MANHOLES ARE TO BE USED ONLY WHEN ACCEPTED BY THE DISTRICT.

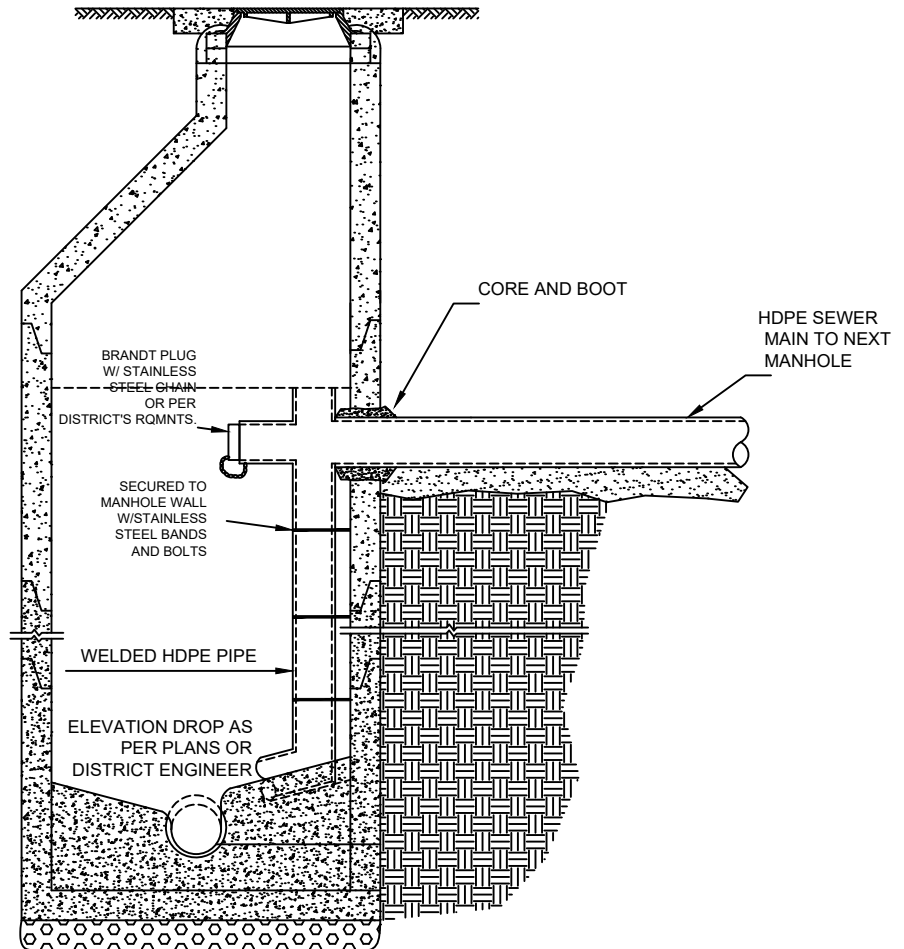

SECTION VIEW "A"

NO SCALE



JORDAN BASIN
IMPROVEMENT DISTRICT

*INSIDE DROP MANHOLE
DETAIL*

DRAWN:	DESIGNED:	CHECKED:	APPROVED:
DATE AUG 2024	FILE NAME	DRAWING NAME SS-1A	