




SECTION A-A

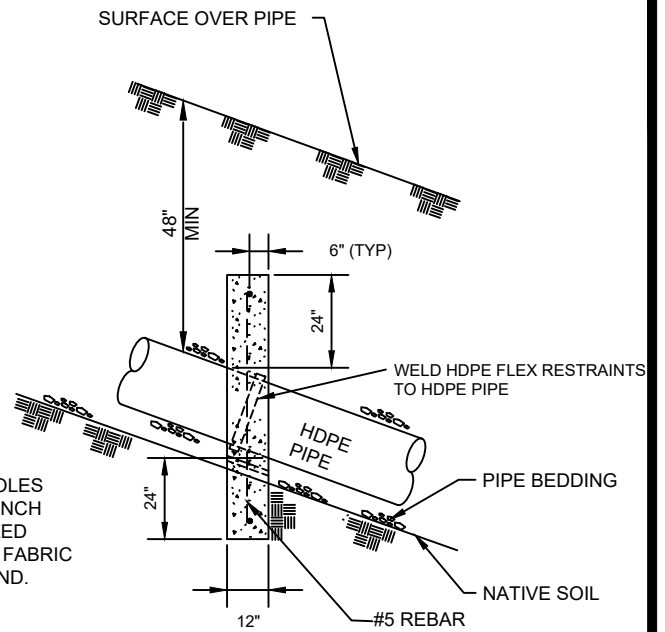

SECTION B-B

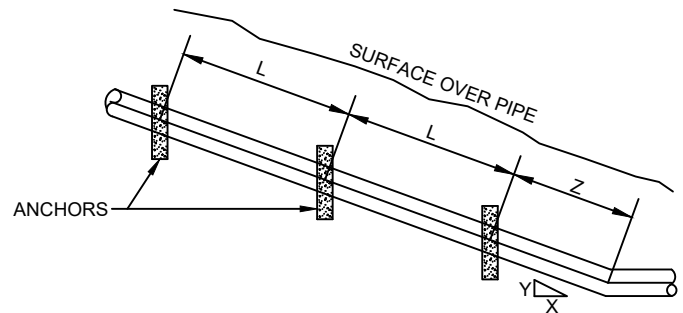

ELEVATION PIPE ANCHORS

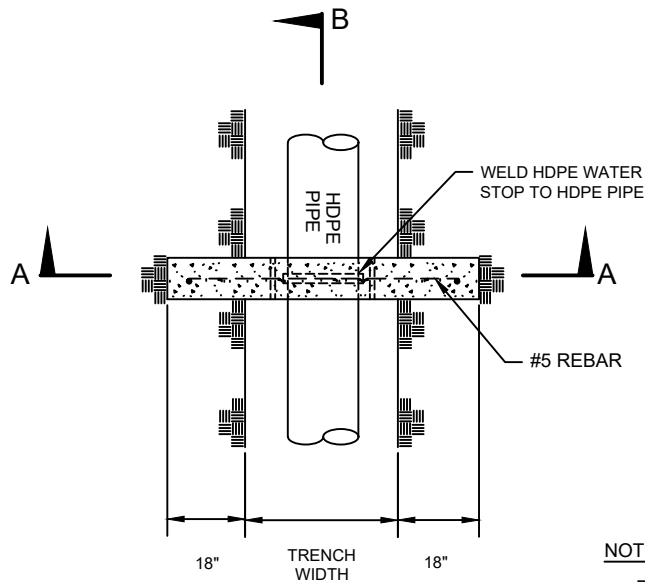

PLAN VIEW

NO SCALE

TABLE "A"		
PIPE SLOPE (%) Y/X	L DISTANCE (MAX)	Z DISTANCE (MAX)
15-35	36'	36'
36-50	24'	24'
51 AND OVER	16'	12'

NOTES:

- PIPE ANCHOR WALLS (CLASS 3000 CONCRETE) SHALL BE CONSTRUCTED USING FORMS. REMOVE FORMS PRIOR TO BACKFILLING TRENCH.
- SEE TABLE "A" FOR SPACING OF ANCHORS VERSUS PIPE SLOPES.



JORDAN BASIN
IMPROVEMENT DISTRICT

**PIPE ANCHOR
DETAIL**

DRAWN:	DESIGNED:	CHECKED:	APPROVED:
DATE AUG 2024	FILE NAME	DRAWING NAME SS-6	