


NOTES:

1. CONTRACTOR SHALL COORDINATE LOCATION OF RADIO ANTENNA, SOLAR PANELS IF NECESSARY, AND FLOW METER ELECTRICAL EQUIPMENT WITH OWNER AND ENGINEER.
2. CONTRACTOR SHALL COORDINATE CONNECTION OF CONDUIT TO METERING MANHOLE WITH ENGINEER.

**RADIO ANTENNA AND FLOW
METER EQUIPMENT DETAIL** 1
9A

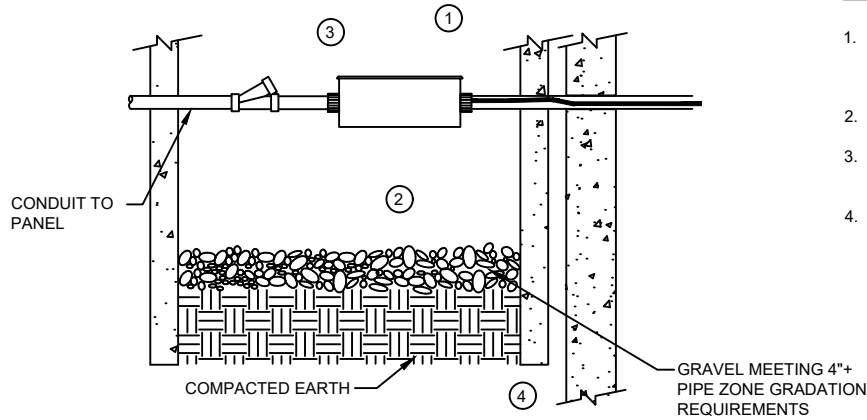

KEY NOTES: #

1. CROUSE-HINDS GUE OR GUB CLASS 1 DIVISION 1 GROUP D JUNCTION BOX OR EQUAL. BOX AND CONDUITS MAY ALSO BE INSTALLED IN VERTICAL POSITION.
2. CROUSE-HINDS EYS CONDUIT SEALING FITTING OR EQUAL.
3. GALVANIZED RIGID STEEL CONDUIT IN CONCRETE OR OUTSIDE OF BOX SHALL BE PVC WRAPPED OR PVC COATED.
4. JUNCTION BOX SIZE DETERMINED BY QUANTITY OF CONNECTIONS AND SIZED BY CONTRACTOR. DEPTH SHALL BE MINIMUM 2.5 FEET.

**JUNCTION BOX
CONNECTION DETAIL** 2
9A

NO SCALE



JORDAN BASIN
IMPROVEMENT DISTRICT

**PALMER BOWLES FLOW
METER DETAIL (2)**

| | | | |
|------------------|-----------|-----------------------|-----------|
| DRAWN: | DESIGNED: | CHECKED: | APPROVED: |
| DATE AUG 2024 | FILE NAME | DRAWING NAME SS-8B | |